

CYCLONE ASSEMBLY COMPONENTS

Comprising of self drilling screw & one piece cyclone washer

TYPE 17 WITH BRA WASHER CYCLONE ASSEMBLY


FOR METAL BATTENS & TIMBER BATTENS

14g -10x65mm


(HEAD MARKING B8, B8V)

All dimensions in mm (nominal)

Screws are Class 4 in accordance with AS3566

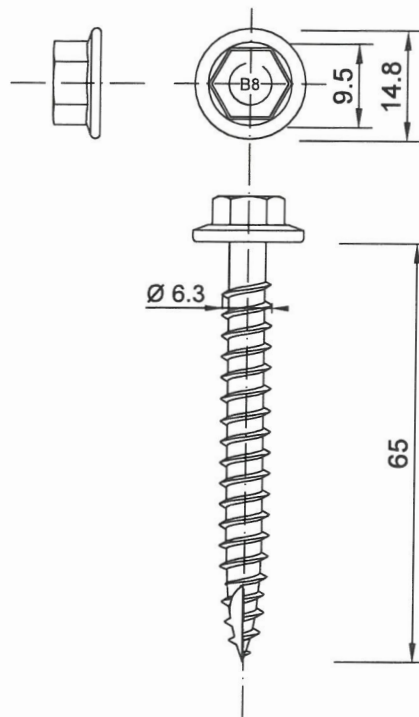


BREMICK BRA - CYCLONE WASHER / SEAL
ONE PIECE ALUMINIUM / EPDM CYCLONE WASHER

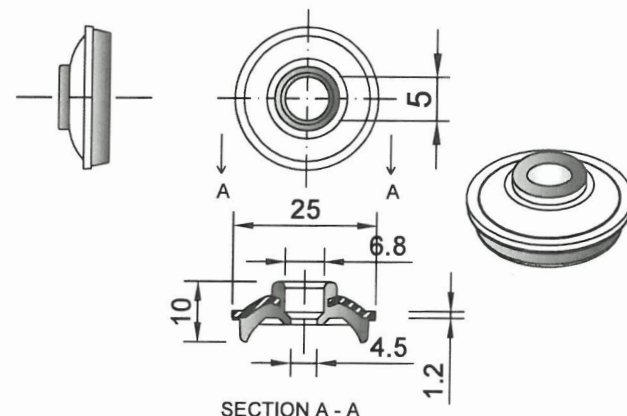

FASTENING:

STEELINE CORRUGATED 762
0.42mm BMT G550 min.

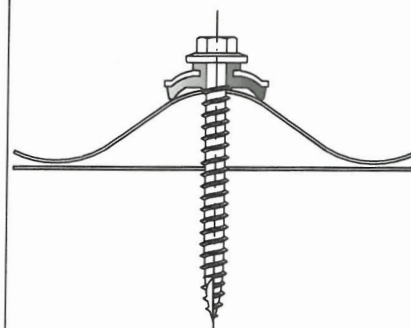


FASTENING TO:

METAL BATTENS
0.75mm BMT min.
G550 min.
TIMBER BATTENS
F14 min.

FASTENING:

STEELINE STEEL CLAD 762
0.42mm BMT G550 min.

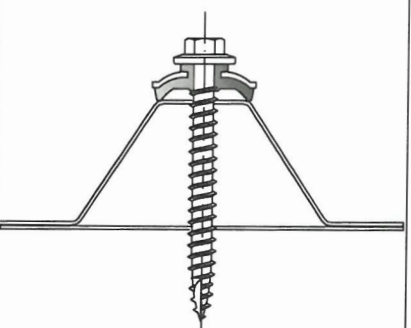


FASTENING TO:

METAL BATTENS
0.75mm BMT min.
G550 min.

CORRUGATED ROOFING PROFILE - STEELINE CORRUGATED 762

FASTENER SPACINGS

Crest Fastener Locations : Alternate Ribs (152mm Centres)
Spans Tested : 900mm End, 1150mm Intermediate, 900mm End

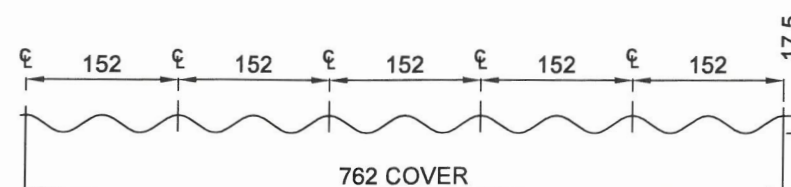


Supports	Crest Fixing
Metal Battens 0.75mm BMT min. G550 min.	Bremick Type 17 14-10x65 BRA
Timber F14 min.	

SQUARE RIB ROOFING PROFILES - STEELINE STEEL CLAD 762

FASTENER SPACINGS

Crest Fastener Locations : Each Rib (190mm Centres)
Spans Tested : 1200mm End, 1500mm Intermediate, 1200mm End

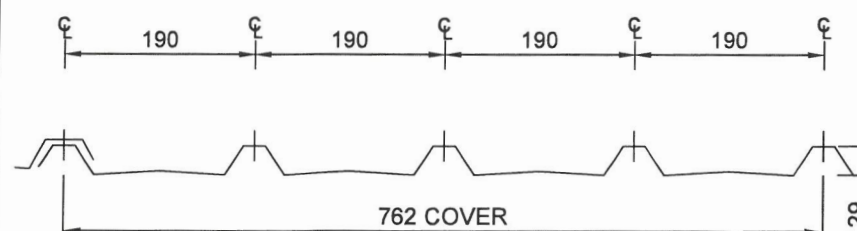

Supports	Crest Fixing
Metal Battens 0.75mm BMT min. G550 min.	Bremick Type 17 14-10x65 BRA

Checking Engineer Name: LEO NOIKOS Registration Number: 70762 Date: 11/8/2025 Signature: [Signature] Must be an Australian registered structural engineer.	Certifying Engineer Name: RACHAEL ZEUNER NT Registration Number: 309710ES Date: 11/8/2025 Signature: [Signature] Must be a registered structural engineer in the Northern Territory
---	--

Product Name

TYPE 17 BRA Cyclone Assembly

Product Description : Roofing Fasteners

T17 14-10 x 65 - BRA Cyclone Assembly
With Steeline Profiles

Manufacturer's Details: BREMICK Pty Ltd
F1, 62 Maddox Street
Alexandria NSW 2015
Ph: 02 8332 1501
Email: sales@bremick.com.au

Design Criteria

Fastener & support spacing to be controlled such that the maximum design loading per fastener or maximum design pressures do not exceed:

Table 1 : Strength Limit State Design Loads per Fastener

Roofing Profile	Test Load (kN)	C.O.V. (K _t)	Design Load (kN)
Corrugated	0.94	1.46	0.64
Steel Clad	1.17	1.46	0.80

Table 2 : Strength Limit State Design Pressures

Roofing Profile	Test Pressure (kPa)	C.O.V. (K _t)	Design Capacity (kPa)
Corrugated	6.02	1.46	4.12
Steel Clad	4.54	1.46	3.11

Limitations

1.This sheet confirms the structural adequacy of the roof sheeting assembly (sheeting, screw and washer) when correctly installed and does not extend to the capacity of the batten/purlin. Refer to the sheeting & batten manufacturers data for maximum support spacings. Axial withdrawal capacity for each fastener exceeds the 3.1kN requirements of AS3566.1: 2002 - Self-drilling screws for building and construction industries - General requirements and mechanical properties.
Strength limit state fastener loads have been derived from the test pressures using simplified static analysis with the uniform pressure (load) distribution.

2.Capacity of assembly pullover may be less than sheeting span capacity. Adjust sheeting spans accordingly.

3.The fastener is only applicable for use with Steeline cladding products with the conditions in this data sheet.

Accepted for Inclusion in Deemed to Comply Manual

DTCM drawing number: M/431/01-01

Chairperson Signature: [Signature]

Chairperson Name: Elisha Harris

Date of Approval: 06/11/2025 Expiry Date: 06/11/2030

Test Certificates

EngTest Report C120908-2, Test 2 Low-High-Low Cyclonic Testing of 0.42mm BMT G550 Corrugated Sheeting with 14-10x65 Type 17 Screws and BRA 25x1.2mm Washers, 13 December 2012
EngTest Report C120908-5, Test 5 Low-High-Low Cyclonic Testing of 0.42mm BMT G550 Steel Span Sheeting with 14-10x65 Type 17 Screws and BRA 25x1.2mm Washers, 13 December 2012